


P-JAL-B-1184
G104213

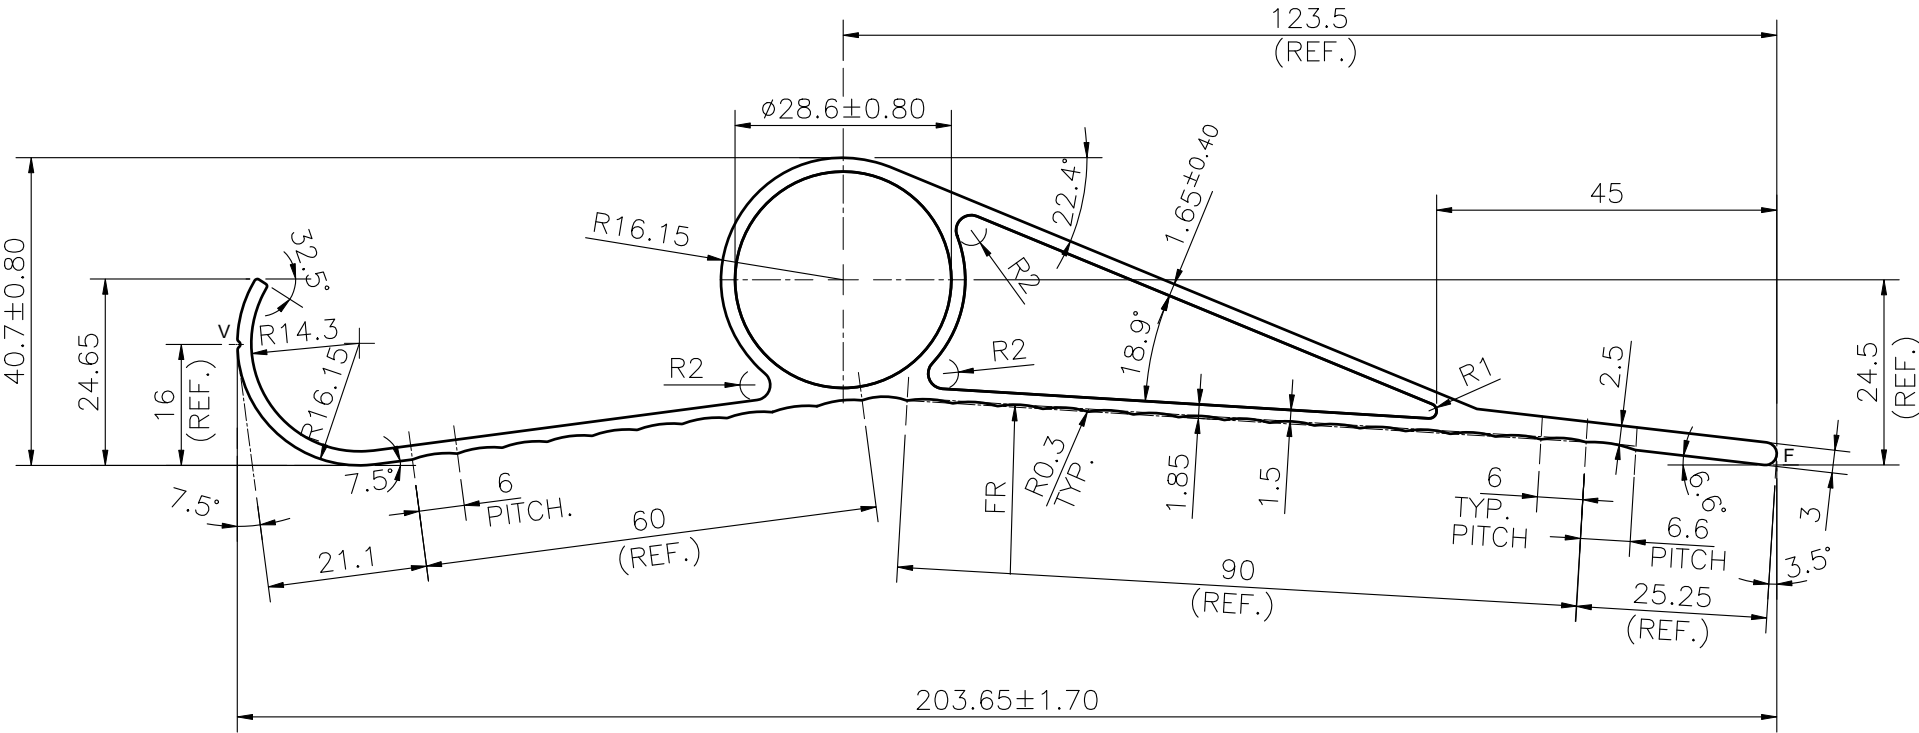

NOTE:-
F= FULL RADIUS (1 PLACE)
V= 0.40x90° V-GROOVE (1 PLACE)

1. STRAIGHTNESS= 1.7mm/M
2. TWIST= 1.7mm/M
3. ANGULARITY= ±2°
4. FLATNESS= 0.007xWIDTH

Q03210

CONTROLLED COPY

 SYMBOL OF QUALITY AN ISO 9001 COMPANY	JINDAL ALUMINIUM LTD. BHIWADI-301019 (INDIA)		DRAWN	ASHUTOSH	18-07-2025
			CHECKED	PARVESH	25-07-2025
			APPROVED	J.N.RAI	25-07-2025
1. ALL DIMENSIONS ARE IN mm. 2. ROUND OFF ALL SHARP CORNERS WITH 0.40 mm. 3. TOLERANCES WILL BE AS PER BS:EN-755-9 , UNLESS OTHERWISE SPECIFIED			SCALE		1:1
			AREA mm ²		728.789
			PERIMETER mm.		485.865
			WEIGHT kg/m		1.968
PARTY'S NAME	UNITED MEDI. EQUIPMENT PVT. LTD., NEW DELHI		DRAWING No.		SECTION No.
PARTY'S DRAWING No.	AS PER CAD & PROPOSAL DRAWING		P-JAL-B-1184		7000004641
ALLOY & TEMPER	6063 T6	PRODUCT CODE:-085		G104213	
		HSN CODE:- 76042100			
DESCRIPTION	MEDICAL EQUIPMENT SECTION				